


## Used 60,000 Gallon Storage Vessel

**Available for Immediate Delivery  
LPG/NGL Service**

This tank is located in Alma, GA

If we do not have a new or used tank or set of matching storage vessels in inventory to suit your needs, we will gladly locate the tanks you need at a competitive price, or we can custom manufacture the tank or set of vessels you require—to your exact specifications.

Year	MFG	Capacity	PSI	Serial No. / National Board No.	U1A Data Report
2001	East Fabricators	60,000	250	15247 / 5903	Available

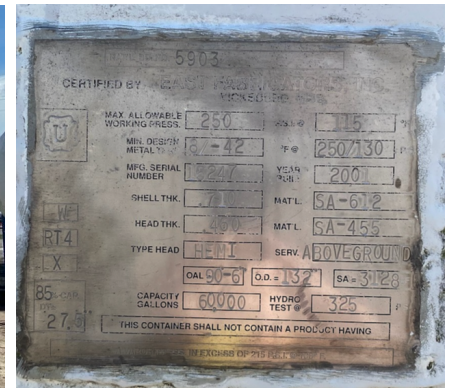

**Need help with your project?** Save time and money, TransTech can provide Valve & Instrumentation kit to fit your tank, freight to the project site and full installation. Feel comfortable your project will be installed to the latest NFPA 58 Standard and will fit your needs.

**Tank Set & Installation!** From providing expert engineering assistance in specifying the correct valve and instrumentation, size piers to coordination of freight and offloading - through to site excavation and tank set, we provide a turnkey bulk plant or terminal solution.



TransTech Energy LLC - Tel: (+1)888-206-4563

[www.transtechenergy.com](http://www.transtechenergy.com)



**FORM U-1A MANUFACTURER'S DATA REPORT FOR PRESSURE VESSELS**  
**(Alternative Form for Single Chamber, Completely Shop-Fabricated Vessels Only)**  
**As Required by the Provisions of the ASME Code Rules, Section VIII, Division 1**

1. Manufactured and certified by East Fabricators, Inc. 1063 Haining Rd., Vicksburg, Ms. 39180  
(Name and address of manufacturer)

2. Manufactured for Pro AM Southeast, ONE NorthShore Center, STE 503, 12 Federal St., Pittsburg, PA 15212  
(Name and address of purchaser)

3. Location of installation same as above  
(Name and address)

4. Type Horiz. 15247 None D 15247 5903 2001  
(Horiz. or vert. tank) (Mfg.'s serial No.) (ICRN) (Drawing No.) (Nat'l. Bd. No.) (Year built)

5. The chemical and physical properties of all parts meet the requirements of material specifications of the ASME BOILER AND PRESSURE VESSEL CODE. The design, construction, and workmanship conform to ASME Rules, Section VIII, Division 1 1998  
Year

to 2000 None None  
Addenda (Date) Code Case Nos. Special Service per UG-120(d)

6. Shell: SA612 .71 0.00 10'-10" 79'-2"  
Matl. (Spec. No., Grade) Nom. Thk. (in.) Corr. Allow. (in.) Diam. I.D. (ft. & in.) Length (overall) (ft. & in.)

7. Seams: Type 1 Full 100 None None Type 1 FULL 8  
Long. (Welded, Dbl., Sngl., Lap, Butt) R.T. (Spot or Full) Eff. (%) H.T. Temp. (°F) Time (hr) Girth (Welded, Dbl., Sngl., Lap, Butt) R.T. (Spot, Partial, or Full) No. of Courses

8. Heads: (a) Matl. SA455 (b) Matl. SA455  
(Spec. No., Grade) (Spec. No., Grade)

	Location (Top, Bottom, Ends)	Minimum Thickness	Corrosion Allowance	Crown Radius	Knuckle Radius	Elliptical Ratio	Conical Apex Angle	Hemispherical Radius	Flat Diameter	Side to Pressure (Convex or Concave)
(a)	End	.4589	0.00	None	None	None	None	65"	None	Concave
(b)	End	.4589	0.00	None	None	None	None	65"	None	Concave

If removable, bolts used (describe other fastenings) None  
(Matl., Spec. No., Gr., Size, No.)

9. MAWP 250 psi at max. temp. 115 °F  
 Min. design metal temp. 8/-42 °F at 250/130 psi. Hydro, pneu., or comb. test pressure 325 psi.

10. Nozzles, inspection and safety valve openings:

Purpose (Inlet, Outlet, Drain)	No.	Diam. or Size	Type	Matl.	Nom. Thk.	Reinforcement Matl.	How Attached	Location
Inspection	1	15"	Pad	SA516-70	250#	None	Welded	Head
Inlet/Outlet	11	1"-3"	CPLG	SA105	6000#	None	Welded	Head/Shell
Thermometer	1	1/2"	TW	SA105	3000#	None	Welded	Head
Outlet	2	1/4"	CPLG	SA105	6000#	None	Welded	Head

11. Supports: Skirt no Lugs 0 Legs 0 Other none Attached none  
(Yes or no) (No.) (No.) (Describe) (Where and how)

12. Remarks: Manufacturer's Partial Data Reports properly identified and signed by Commissioned Inspectors have been furnished for the following items of the report: none  
(Name of part, item number, Mfg.'s. name and identifying stamp)

Impact test exempt per UCS-66(b)

This vessel is not for lethal service. The owner/user is responsible for installation of pressure relief devices per UG-125.

CERTIFICATE OF SHOP COMPLIANCE	
We certify that the statements made in this report are correct and that all details of design, material, construction, and workmanship of this vessel conform to the ASME Code for Pressure Vessels, Section VIII, Division 1. "U" Certificate of Authorization No. <u>16395</u> expires <u>12-9-2001</u> . Date <u>7-13-01</u> Co. name <u>East Fabricators, Inc.</u> Signed <u>[Signature]</u> <small>(Manufacturer) (Representative)</small>	
CERTIFICATE OF SHOP INSPECTION	
Vessel constructed by <u>East Fabricators, Inc.</u> at <u>Vicksburg, MS. 39180</u> I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and/or the State or Province of <u>Mississippi</u> and employed by <u>H.S.B. I. &amp; I. CO.</u> have inspected the component described in this Manufacturer's Data Report on <u>7/13</u> , <u>12-2001</u> , and state that, to the best of my knowledge and belief, the Manufacturer has constructed this pressure vessel in accordance with ASME Code, Section VIII, Division 1. By signing this certificate neither the Inspector nor his employer makes any warranty, expressed or implied, concerning the pressure vessel described in this Manufacturer's Data Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection. Date <u>7/13/01</u> Signed <u>[Signature]</u> Commissions <u>167779 A MS35</u> <small>(Authorized Inspector) (Nat'l Board (incl. endorsements), State, Prov. and No.)</small>	